



Seri net	Local network. 6 units max.	02/03
Wall unit	MK2A25 with temp.sensor	04/05
Temp 1	Return air. Optional (will be dominant)	06/07
Temp 2	Supply water temp. for configurations B, C and D	08/09
Input 1	Occupancy (must be bridged if not used)	10/11
Power out	24V DC to power occupancy sensor	12
Input 2	12V DC. Unit switches off when high	13/14
Analog out	Fan 0-10V control	15/16
Power out	24V DC output for sensor use	17
Analog out	Cooling valve 0-10V control	18/19
Analog out	Heating valve 0-10V control	20/21
Power in	230V AC	C/D

Note:

Input from occupancy sensor must be a voltage free contact.
 Closed for occupied.
 24V DC available to power occupancy sensor.

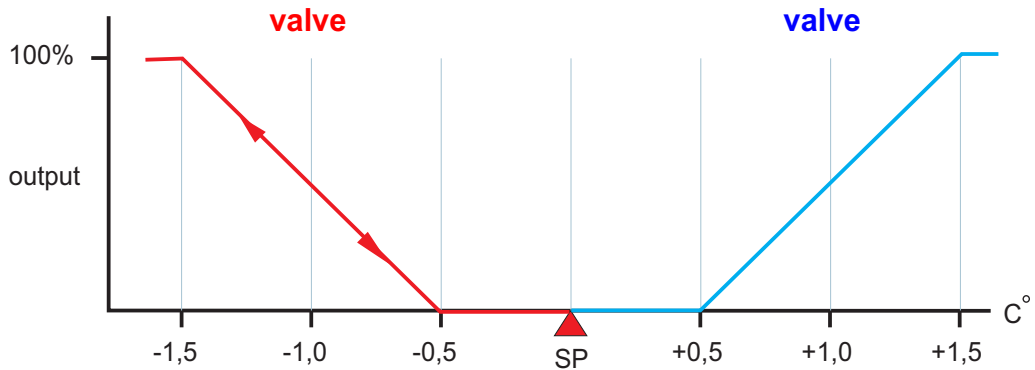

DEMAN

MM2SA70A fan coil controller