

**Notes on this example:**


- 1) No Neutral or Live looping on terminals.
- 2) Room unoccupied (open contact), places controller in unoccupied mode.  
(Bridge 10/11 if not in use.) (master unit only)
- 3) Supply water temperature is measured for auto change over - heating or cooling mode. Leave out if cooling water only. (master unit only)
- 4) If the return air temperature sensor is not installed room temperature is measured at the master unit's wall unit.
- 5) 12V DC input causes the controllers to switch off in an orderly manner. (master unit only)

**References:** MM2Q51 (controller doc.) and MK2Q11 (wall unit doc.) and MM2NETQ10 (local net doc.)

Seri net	Local network. 6 units max.	02/03
Wall unit	MK2A25 with temp.sensor	04/05
Temp 1	Return air. Optional (will be dominant)	06/07
Temp 2	Supply water temp	08/09
Input 1	Occupancy (must be bridged if not used)	10/11
Power out	24V DC to power occupancy sensor	12
Input 2	12V DC. Unit switches off when high	13/14
N	Neutral out to Fan	15
relay 1 out	Fan low. 230V AC 3A	16
relay 2 out	Fan med. 230V AC 3A	17
relay 3 out	Fan high 230V AC 3A	18
Analog out	Valve 0-10V control	20/21
relay out	Heater 230V AC (on/off) 1,5kW, max 2kW	A/B
Power in	230V AC	C/D

**Note:**

Input from occupancy sensor must be a voltage free contact.  
 Closed for occupied.  
 24V DC available to power occupancy sensor.

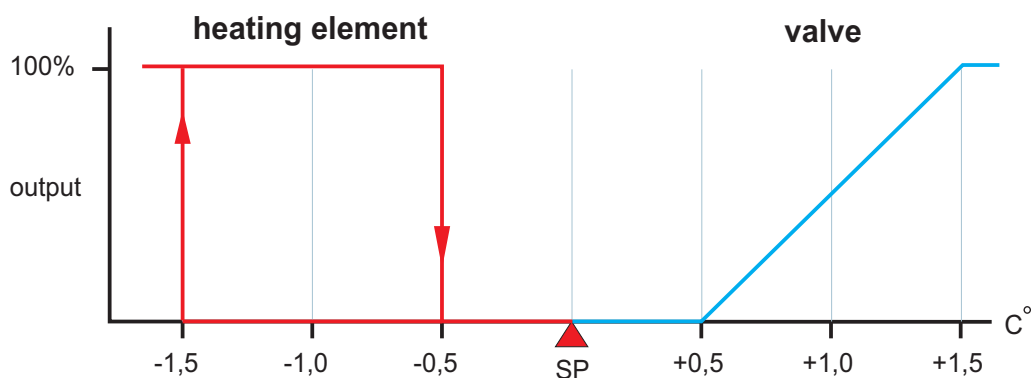

**DEMAN**

**MM2SA51 fan coil controller**