

Bridge 10-11 if not in use and AV 36 Mode Value = 0.
Do not bridge any other.



MM2BA51 Fan Coil Controller


BMS	BACnet	01/02/03
Wall unit	MK2A25 with temp.sensor	04/05
Temp 1	Return air. Optional (will be dominant)	06/07
Temp 2	Supply water temp	08/09
Input 1	Occupancy (must be bridged if not used)	10/11
Power out	24V DC to power occupancy sensor	12
Input 2	12V DC. Unit switches off when high	13/14
N	Neutral out to Fan	15
relay 1 out	Fan low. 230V AC 3A	16
relay 2 out	Fan med. 230V AC 3A	17
relay 3 out	Fan high 230V AC 3A	18
Analog out	Valve 0-10V control	20/21
relay out	Heater 230V AC (on/off) 1,5kW, max 2kW	A/B
Power in	230V AC	C/D

Note:

Sensor input to terminals 10/11 must be a voltage free contact.
24V DC available to power sensor.

Occupancy input (AV 36 Mode = 0) closed = room occupied.
Fan only (AV 36 Mode = 1) closed = fan only. No heating or cooling.
On/Off (AV 36 Mode = 2) closed = unit switches off.
Heater interlock (AV 36 Mode = 3) open = no heating.
Humidistat input (AV 36 Mode = 4) closed = unit does de-humidification.

BACnet doc: MM2BACQ12

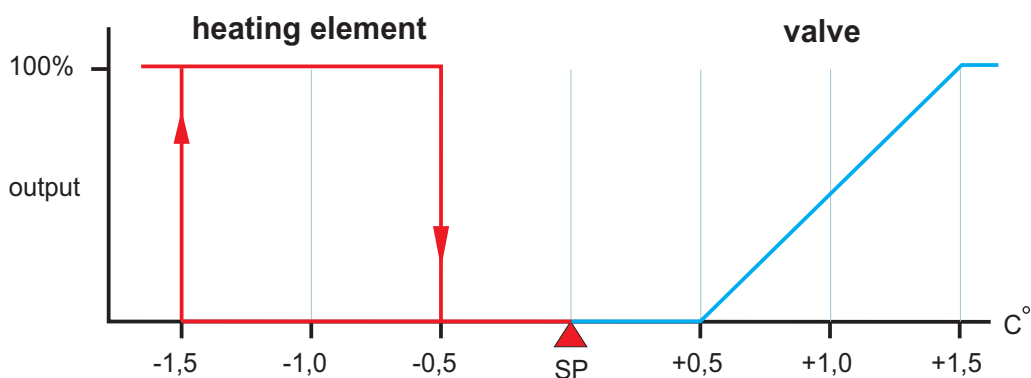

DEMAN

MM2A51 fan coil controller